






Headline Statistics

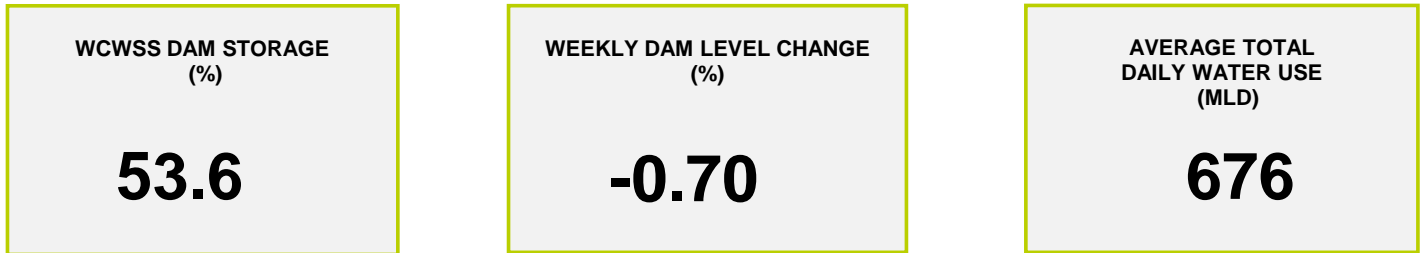

Water Production from Different Sources

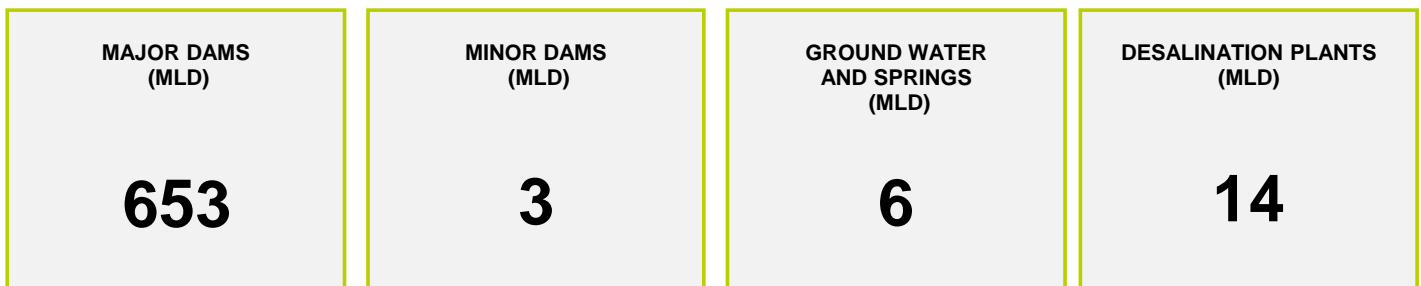

Overall Water Usage Trend (2010 - Present)

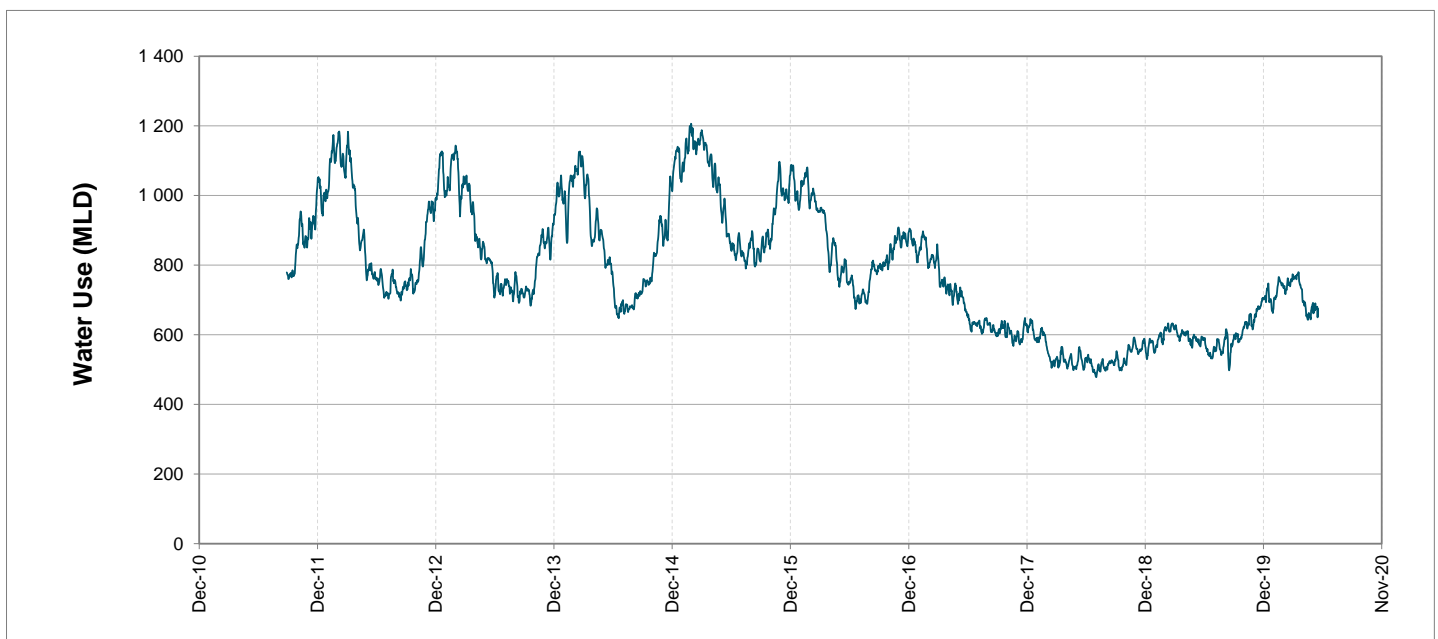

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **53.6%**


Weekly Change **-0.7%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	18 May 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	65.6	66.2	68.0	39.1	32.0	27.2
STEENBRAS LOWER	33 517	48.4	50.2	38.1	34.2	25.8	36.4
STEENBRAS UPPER	31 767	96.5	96.5	66.3	56.4	55.1	56.6
THEEWATERSKLOOF	480 188	50.2	50.8	35.8	12.1	14.7	31.0
VOÉLVLEI	164 095	50.4	51.0	54.9	14.5	16.8	21.2
WEMMERSHOEK	58 644	43.3	44.9	42.2	47.9	36.1	47.7
TOTAL STORED	898 221	481 370	487 401	409 136	189 932	186 971	276 923
% STORAGE		53.6%	54.3%	45.5%	21.1%	20.8%	30.8%




WCWSS Storage Record (2008 - Present)

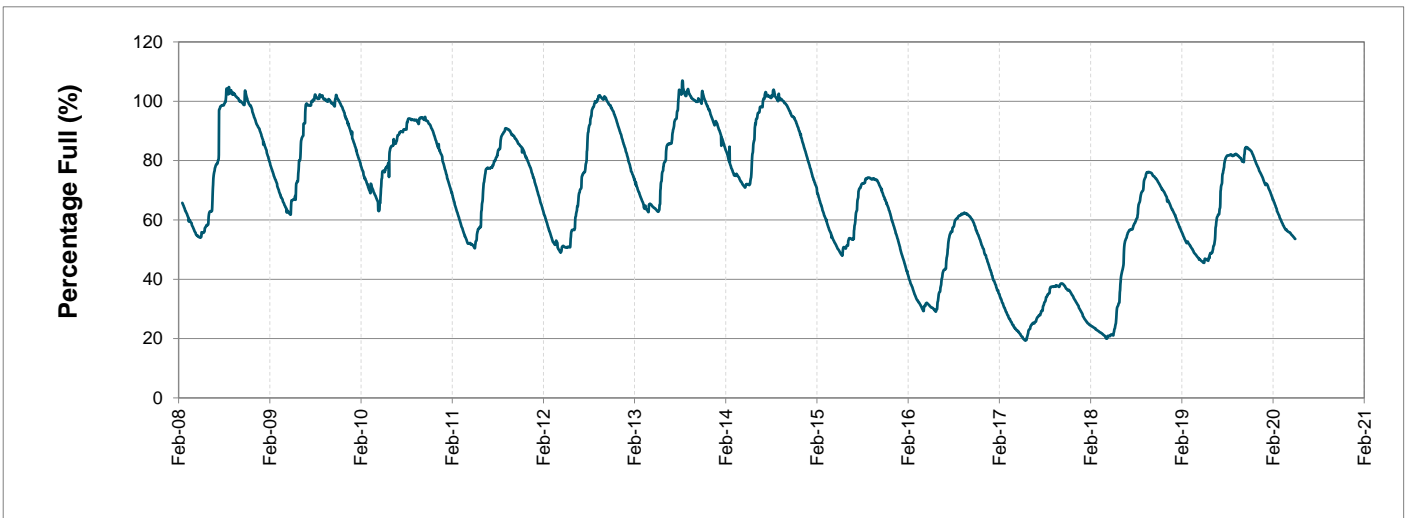

WCWSS Comparative Storage Graph (5 Years)

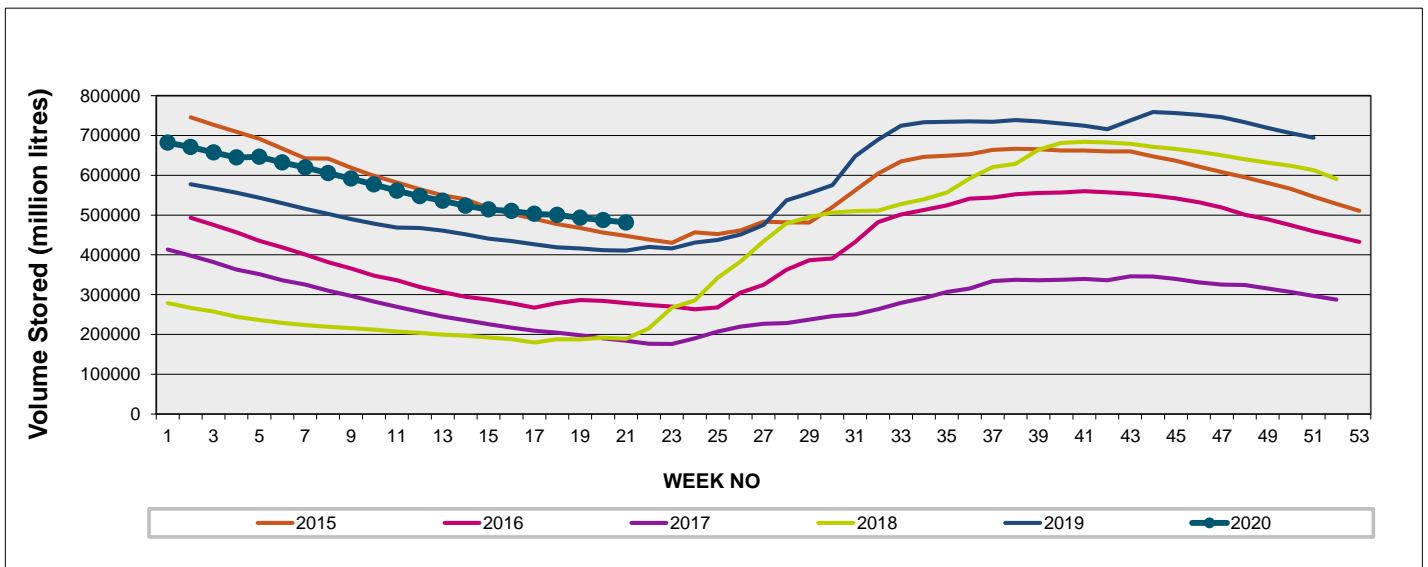

WCWSS Dam Storage and Water Use Tracking

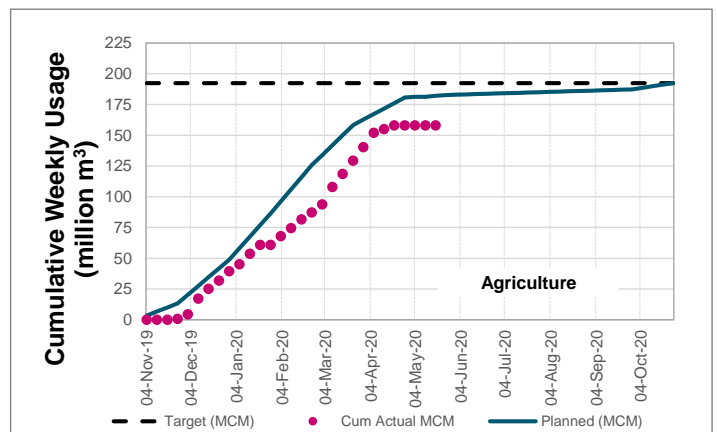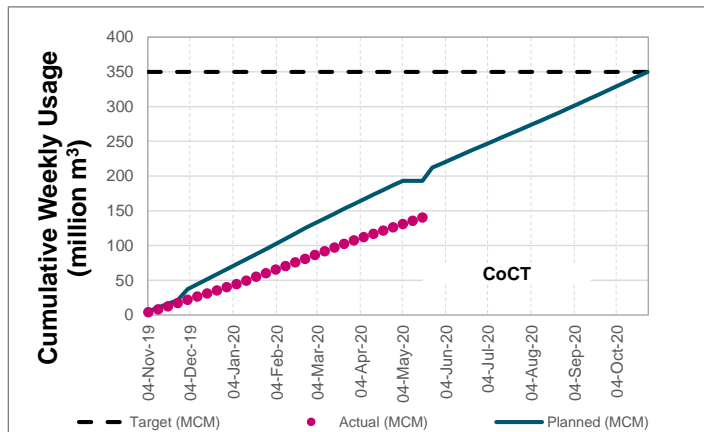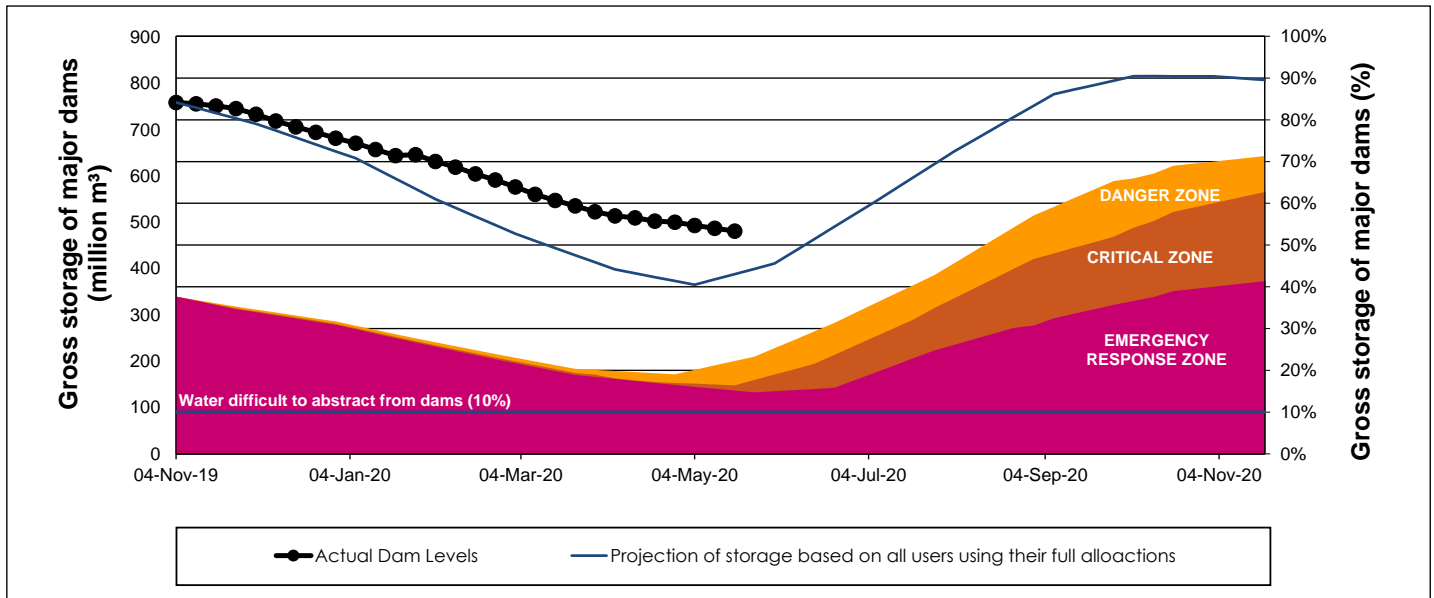

Water Stored in Minor Dams

Overall Percentage Full **50.0**

Weekly Change **-0.18**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	18 May 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	33.4	33.9	0.0	75.3	30.5	14.5
DE VILLIERS (Table Mountain)	243	93.6	94.0	60.5	48.6	42.5	88.5
HELY-HUTCHINSON (Table Mountain)	925	12.3	12.5	5.0	65.6	98.6	56.3
KLEINPLAATS (Simon's Town)	1 368	37.1	37.7	43.3	37.7	40.0	30.5
LAND-EN-ZEEZICHT (Helderberg)	451	61.8	61.1	99.0	89.3	69.5	18.5
LEWIS GAY (Simon's Town)	182	0.4	0.0	0.0	69.7	12.0	1.7
VICTORIA (Table Mountain)	128	72.4	73.7	4.6	22.3	69.8	0.0
WOODHEAD (Table Mountain)	954	97.8	97.7	56.7	58.9	72.3	82.5
Total Stored	4 377	2187.9	2195.9	1770.8	2445.9	2704.8	2029.4
Percentages stored		50.0	50.2	40.5	55.9	61.8	46.4


Rainfall Recorded

RAINFALL (mm)	11-May	12-May	13-May	14-May	15-May	16-May	17-May	May	
								Total*	LT Average
Blackheath Upper	0.0	0.0	0.0	0.0	1.5	0.0	0.0	12.8	56.4
Brooklands	0.0	0.0	0.0	0.0	0.0	0.0	0.0	9.0	109.3
Newlands	0.0	0.0	0.0	0.0	1.5	0.0	0.0	10.3	210.3
Steenbras	0.0	0.0	0.0	5.4	0.0	0.0	0.0	21.9	117.7
Table Mountain (Woodhead)	0.0	0.0	5.5	0.0	0.0	0.0		39.5	189.5
Theewaterskloof	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.9	48.7
Tygerberg	0.0	0.0	0.0	0.0	1.3	0.0	0.0	2.7	60.3
Voëlvele	0.0	0.0	0.0	0.0	2.2	0.0	0.0	4.9	70.8
Wemmershoek	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6	121.6
Wynberg	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	147.7

Notes: *Total/cumulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountaneous location

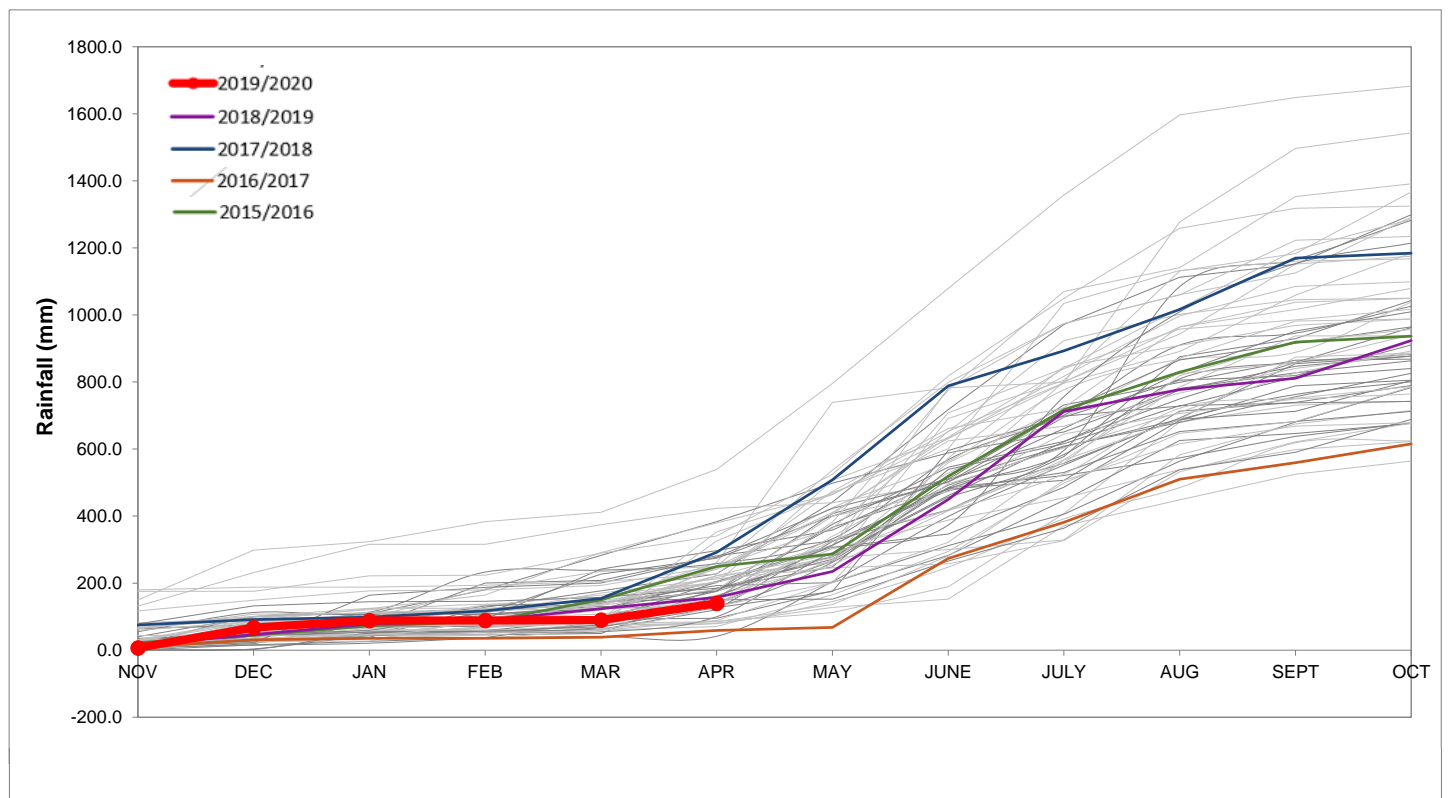

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Jan-19	99.00	98
Feb-19	99.05	98
Mar-19	99.01	98
Apr-19	99.10	98
May-19	99.08	98
Jun-19	99.09	98
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.